


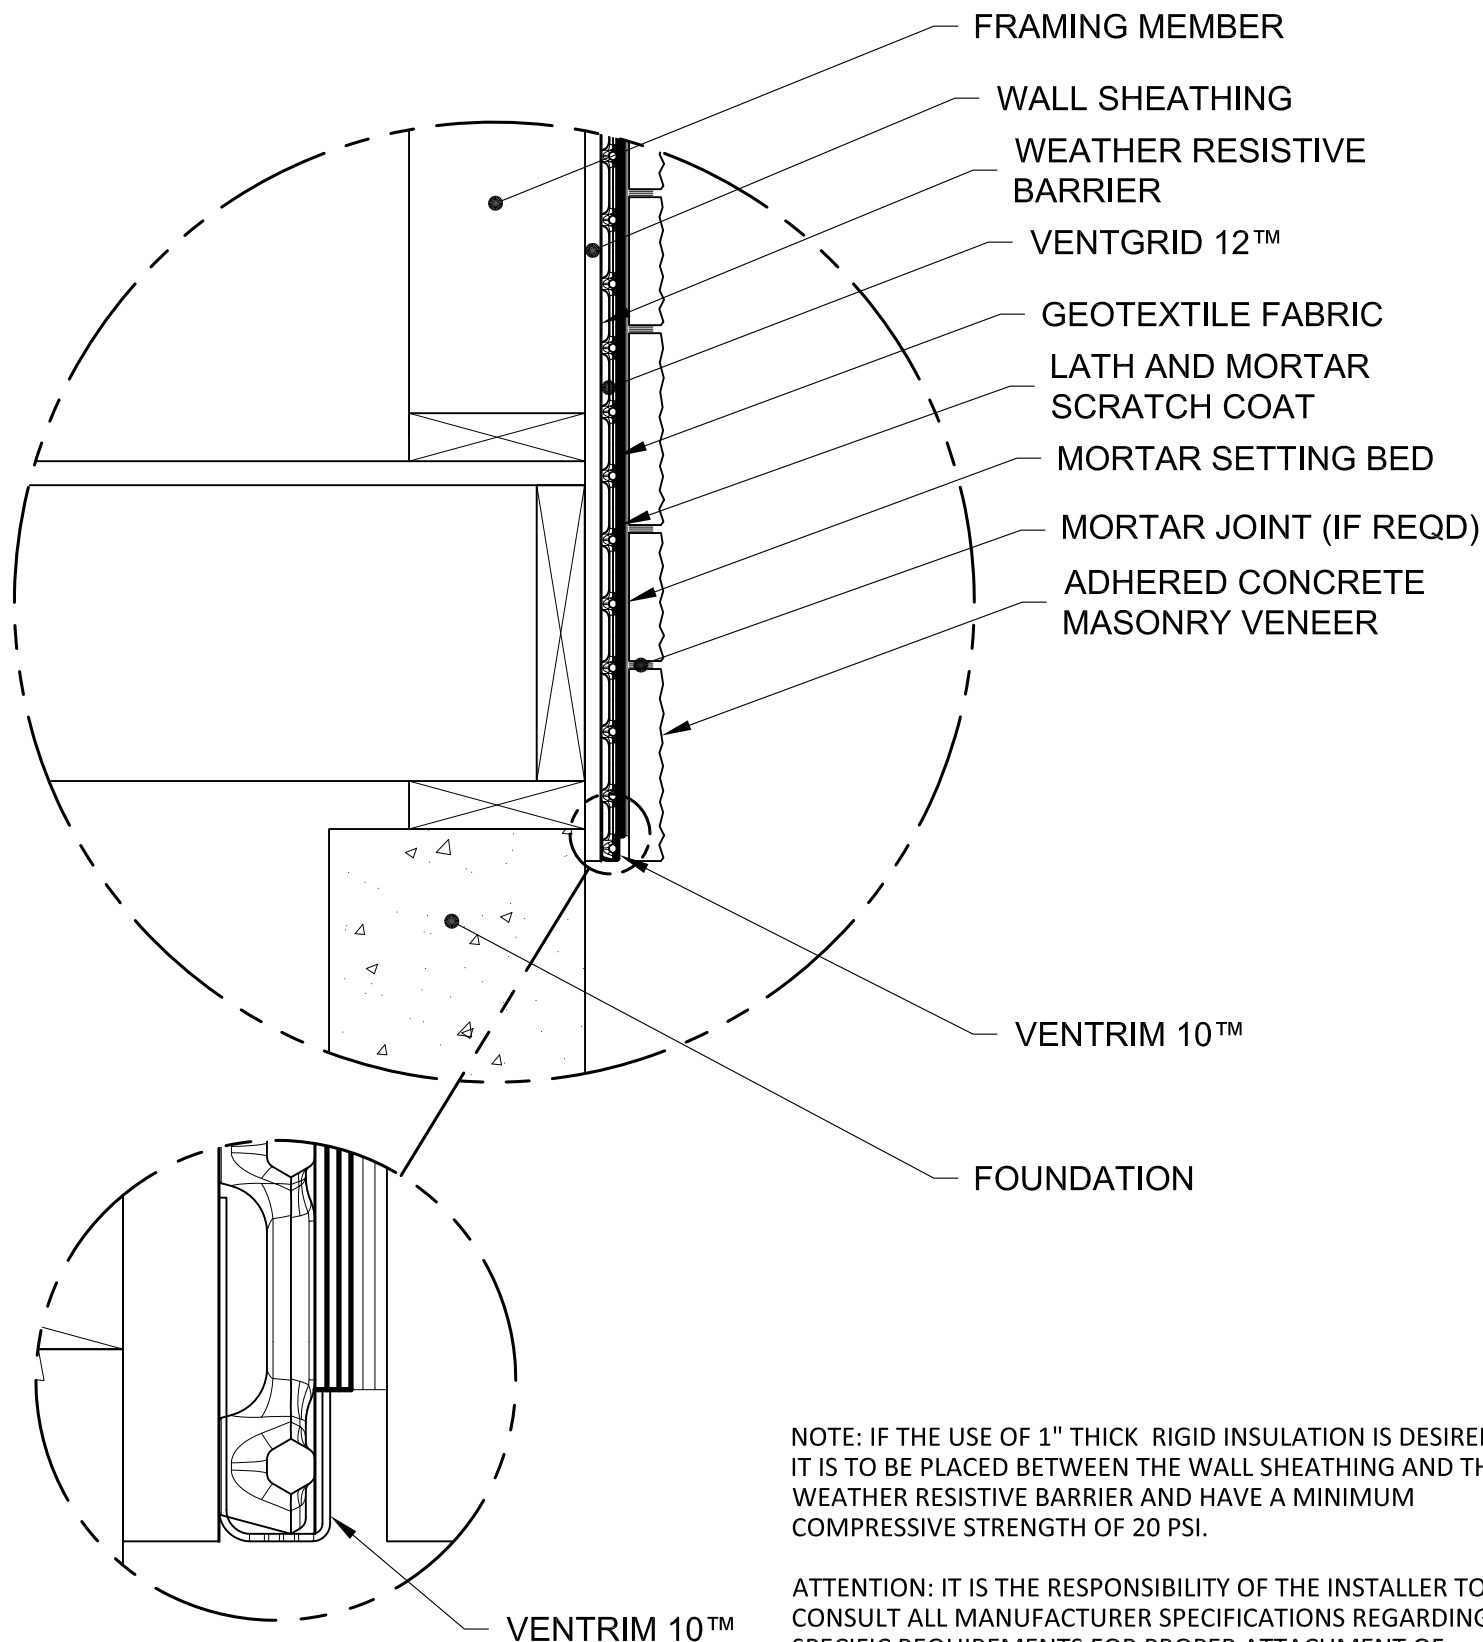


BOTTOM OF WALL DETAIL

VENTGRID 12™ & VENTRIM 10™

NOT TO SCALE

ASSEMBLY SHOWN WITH ADHERED CONCRETE MASONRY VENEER
ON LATH AND MORTAR SCRATCH COAT

VG12-007

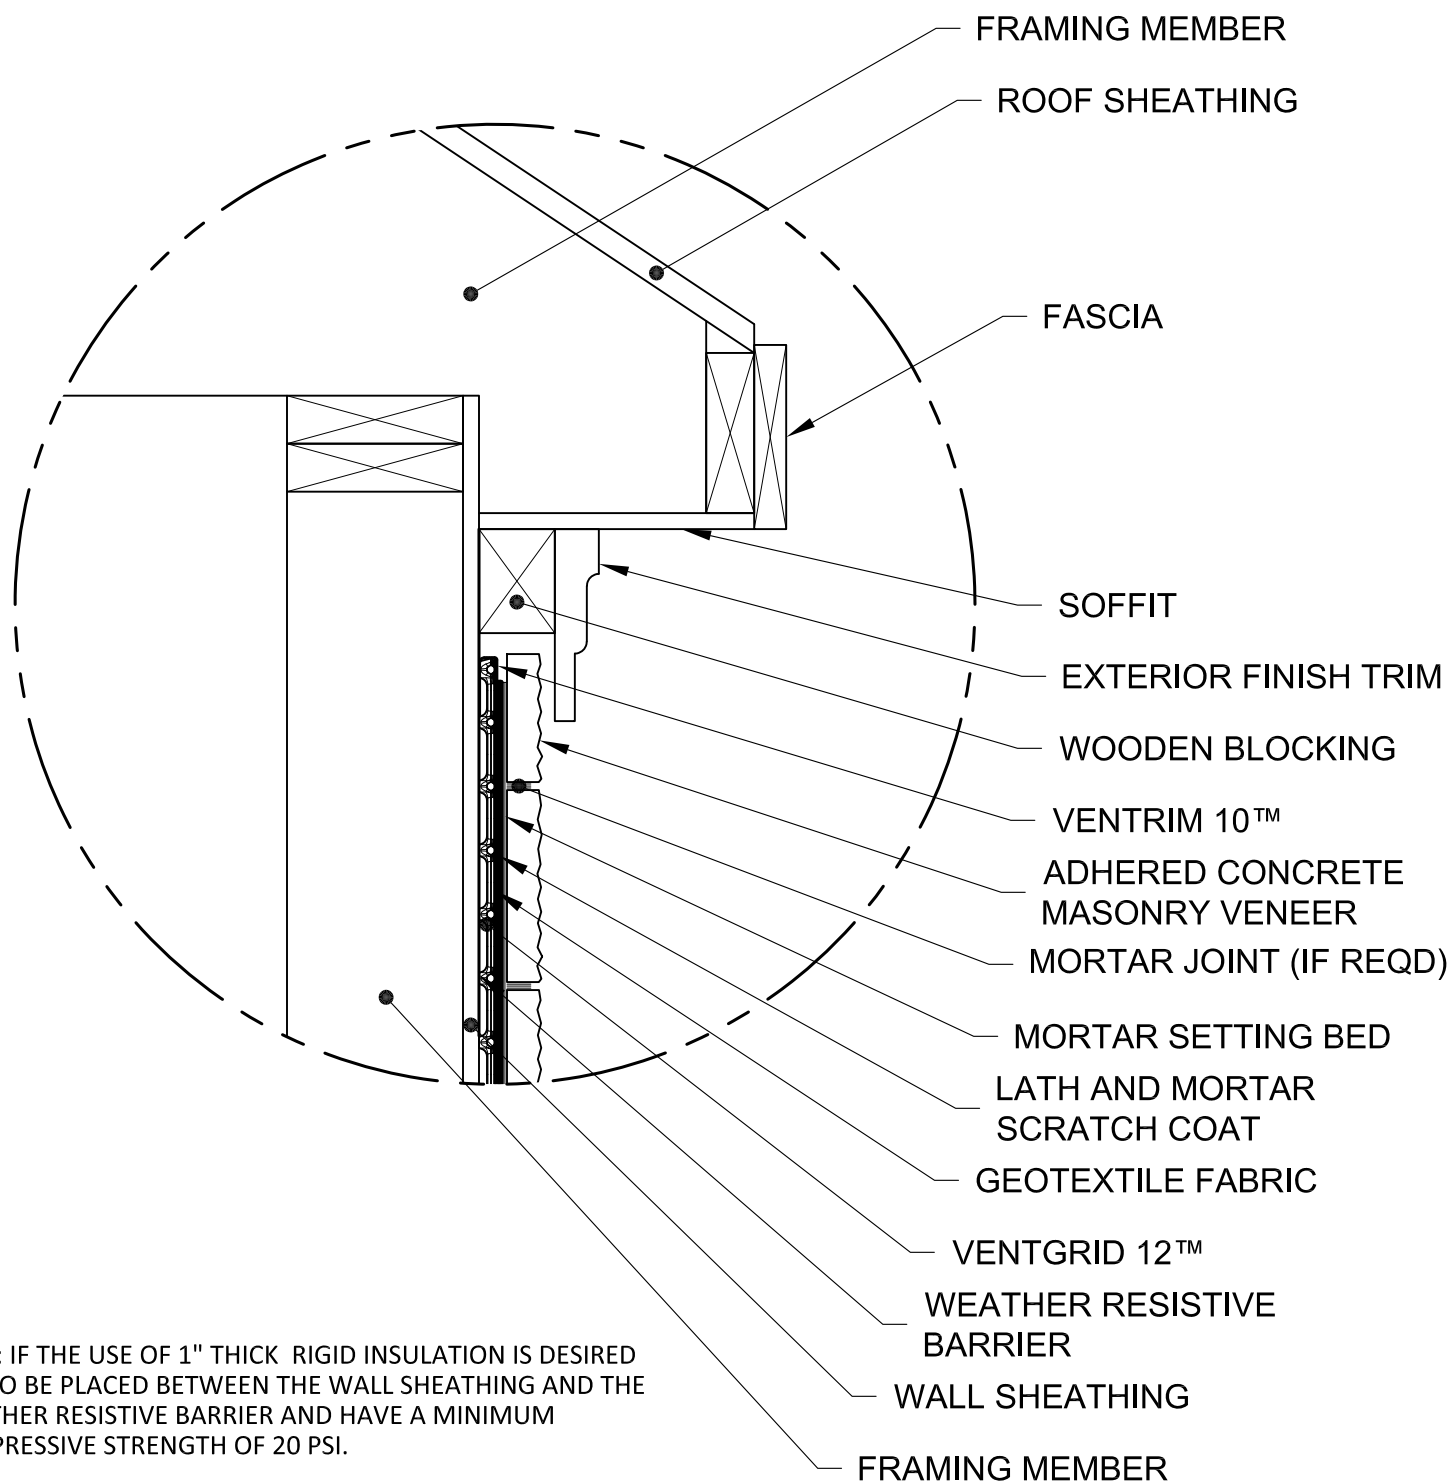

NOTE: IF THE USE OF 1" THICK RIGID INSULATION IS DESIRED IT IS TO BE PLACED BETWEEN THE WALL SHEATHING AND THE WEATHER RESISTIVE BARRIER AND HAVE A MINIMUM COMPRESSIVE STRENGTH OF 20 PSI.

ATTENTION: IT IS THE RESPONSIBILITY OF THE INSTALLER TO CONSULT ALL MANUFACTURER SPECIFICATIONS REGARDING SPECIFIC REQUIREMENTS FOR PROPER ATTACHMENT OF MATERIALS AND TO ALSO ENSURE MATERIAL INSTALLATION CONFORMS TO LOCAL CODE REQUIREMENTS.

ROOF EDGE & TOP OF WALL DETAIL


VENTGRID 12™ & VENTRIM 10™

NOT TO SCALE

ASSEMBLY SHOWN WITH ADHERED CONCRETE MASONRY VENEER
ON LATH AND MORTAR SCRATCH COAT

VG12-107



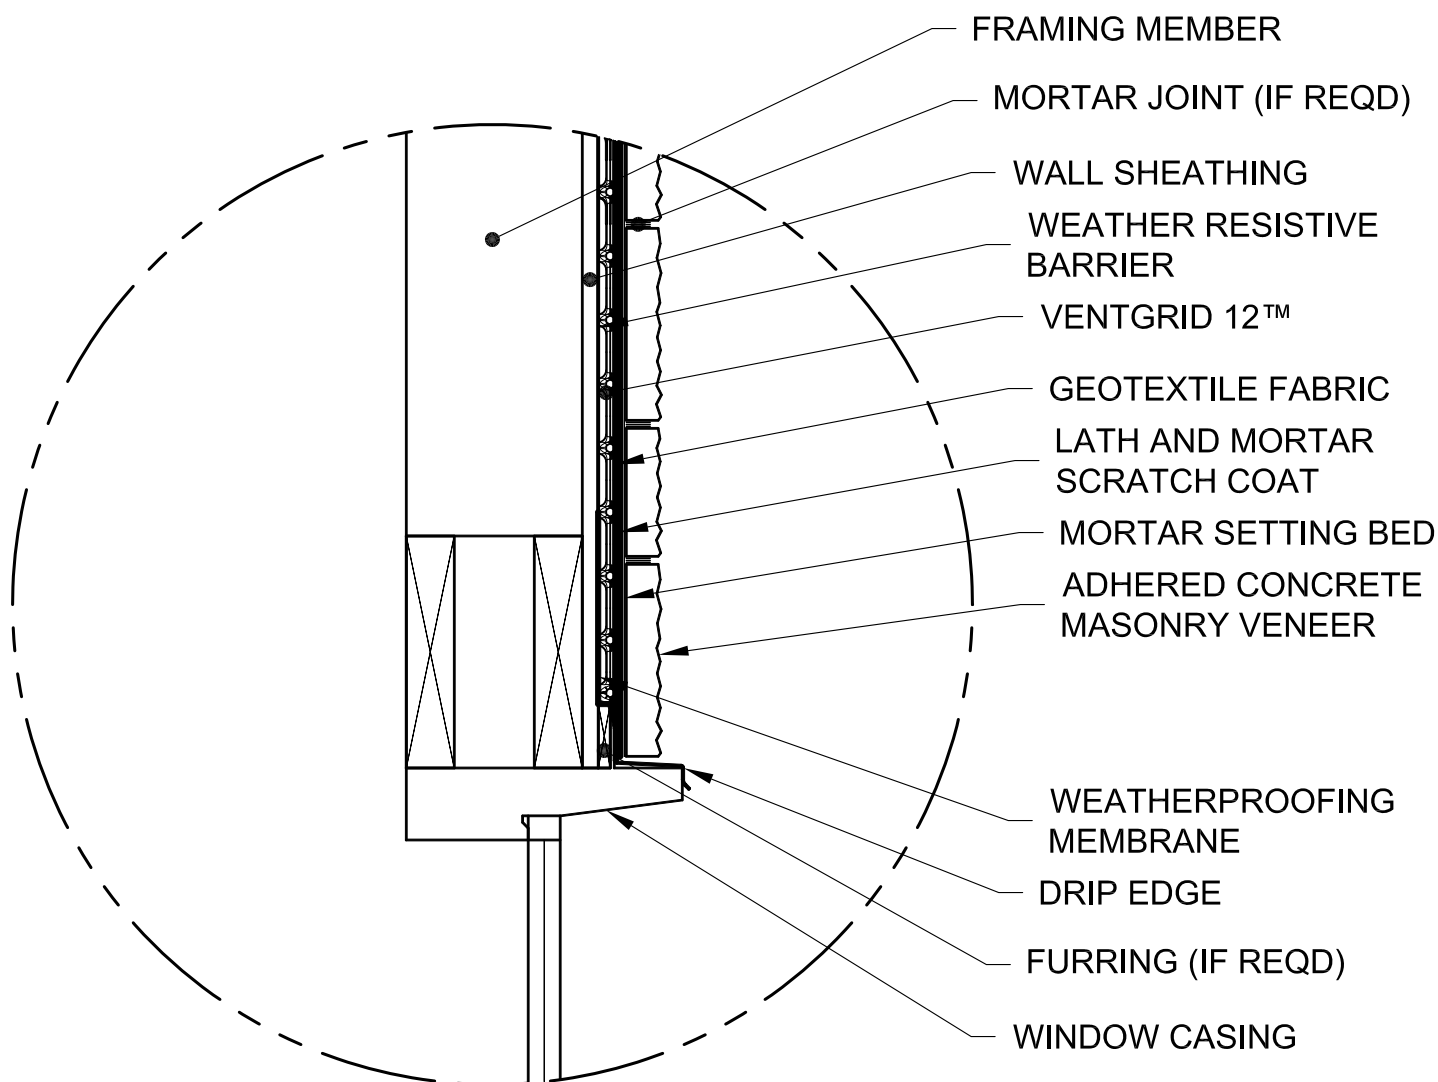

NOTE: IF THE USE OF 1" THICK RIGID INSULATION IS DESIRED IT IS TO BE PLACED BETWEEN THE WALL SHEATHING AND THE WEATHER RESISTIVE BARRIER AND HAVE A MINIMUM COMPRESSIVE STRENGTH OF 20 PSI.

ATTENTION: IT IS THE RESPONSIBILITY OF THE INSTALLER TO CONSULT ALL MANUFACTURER SPECIFICATIONS REGARDING SPECIFIC REQUIREMENTS FOR PROPER ATTACHMENT OF MATERIALS AND TO ALSO ENSURE MATERIAL INSTALLATION CONFORMS TO LOCAL CODE REQUIREMENTS.




WINDOW HEAD DETAIL

VENTGRID 12™

NOT TO SCALE

ASSEMBLY SHOWN WITH ADHERED CONCRETE MASONRY VENEER
ON LATH AND MORTAR SCRATCH COAT

VG12-203

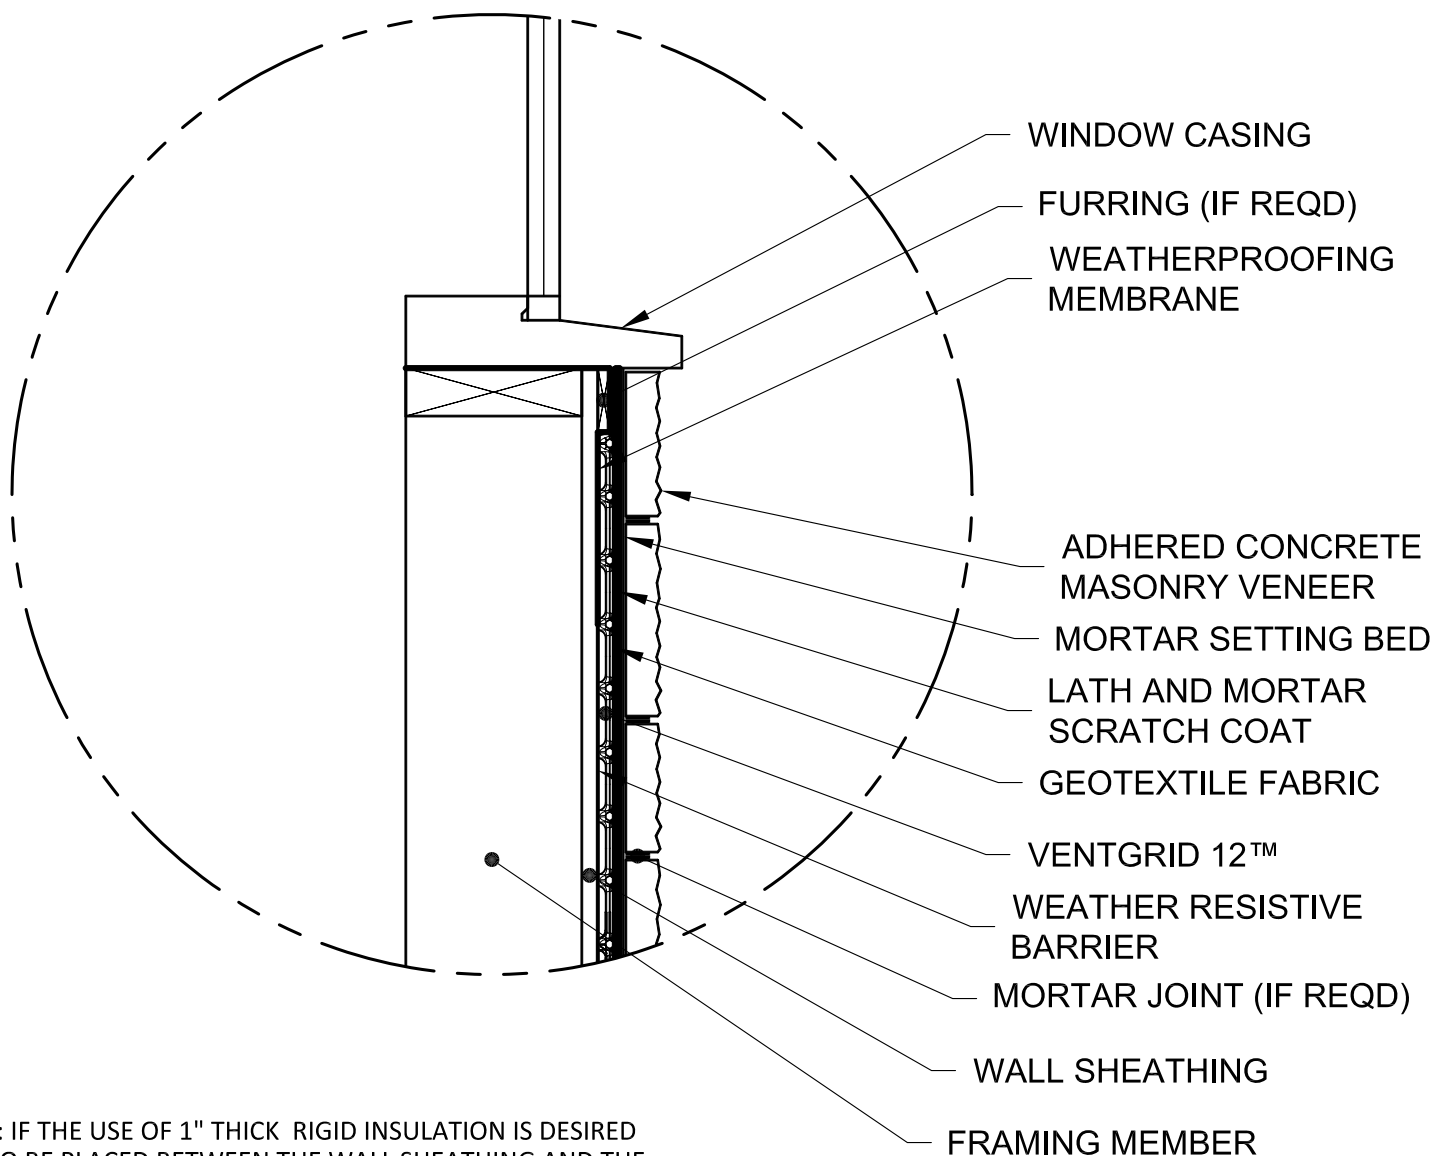

NOTE: IF THE USE OF 1" THICK RIGID INSULATION IS DESIRED IT IS TO BE PLACED BETWEEN THE WALL SHEATHING AND THE WEATHER RESISTIVE BARRIER AND HAVE A MINIMUM COMPRESSIVE STRENGTH OF 20 PSI.

ATTENTION: IT IS THE RESPONSIBILITY OF THE INSTALLER TO CONSULT ALL MANUFACTURER SPECIFICATIONS REGARDING SPECIFIC REQUIREMENTS FOR PROPER ATTACHMENT OF MATERIALS AND TO ALSO ENSURE MATERIAL INSTALLATION CONFORMS TO LOCAL CODE REQUIREMENTS.




WINDOW SILL DETAIL

VENTGRID 12™

NOT TO SCALE

ASSEMBLY SHOWN WITH ADHERED CONCRETE MASONRY VENEER
ON LATH AND MORTAR SCRATCH COAT

VG12-303

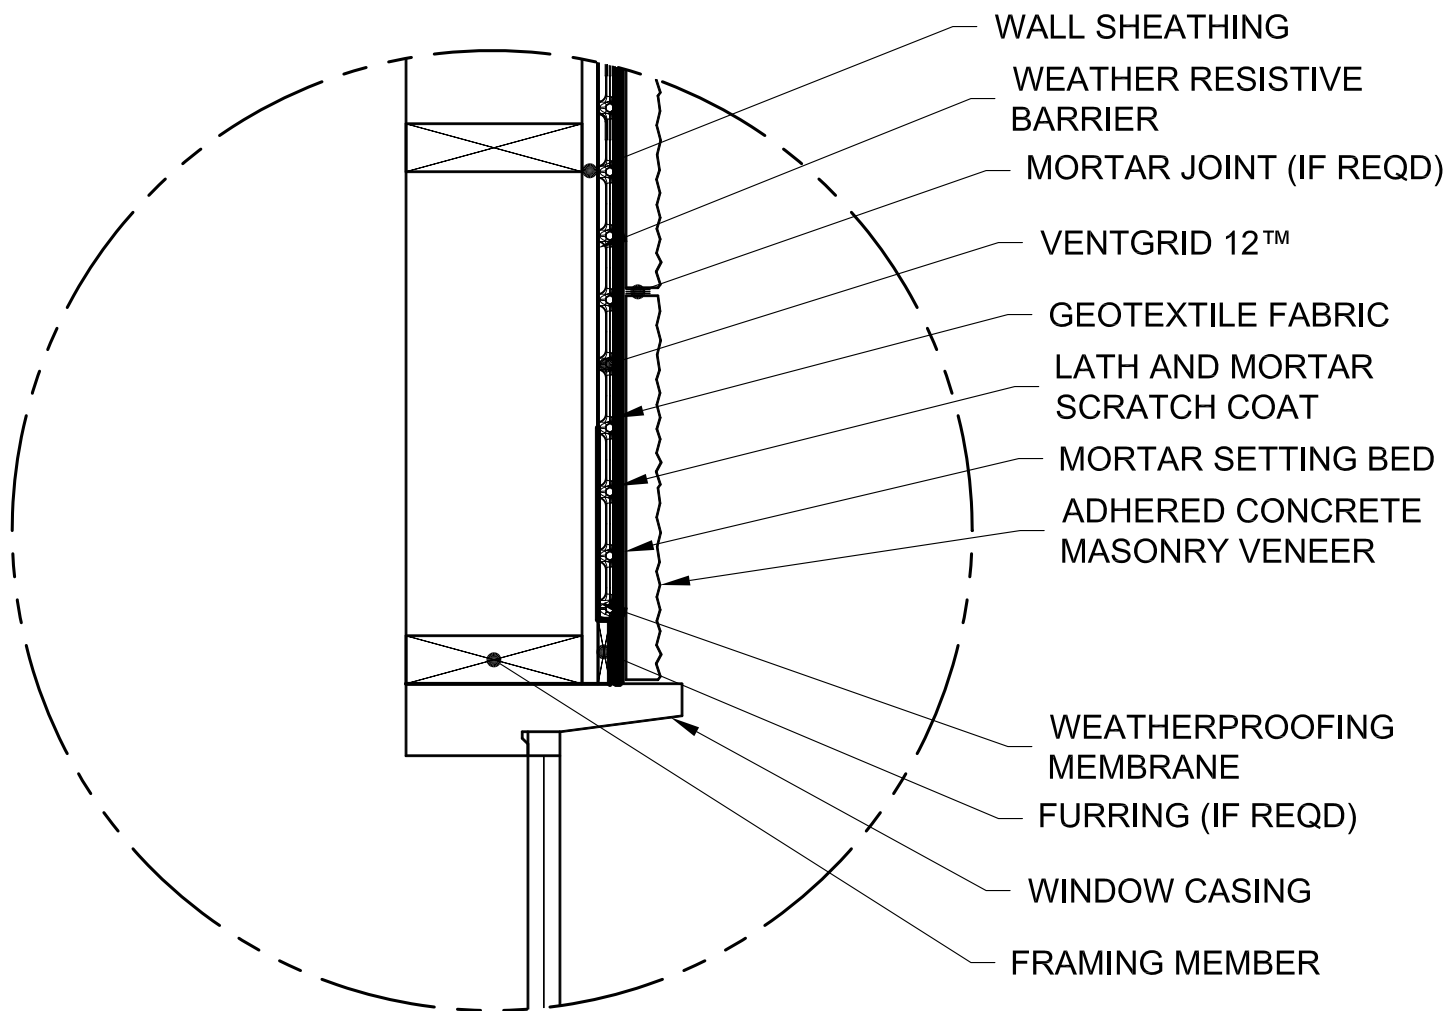

NOTE: IF THE USE OF 1" THICK RIGID INSULATION IS DESIRED IT IS TO BE PLACED BETWEEN THE WALL SHEATHING AND THE WEATHER RESISTIVE BARRIER AND HAVE A MINIMUM COMPRESSIVE STRENGTH OF 20 PSI.

ATTENTION: IT IS THE RESPONSIBILITY OF THE INSTALLER TO CONSULT ALL MANUFACTURER SPECIFICATIONS REGARDING SPECIFIC REQUIREMENTS FOR PROPER ATTACHMENT OF MATERIALS AND TO ALSO ENSURE MATERIAL INSTALLATION CONFORMS TO LOCAL CODE REQUIREMENTS.



WINDOW JAMB DETAIL

VENTGRID 12™

NOT TO SCALE

ASSEMBLY SHOWN WITH ADHERED CONCRETE MASONRY VENEER
ON LATH AND MORTAR SCRATCH COAT

VG12-403